

STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION  
DESIGN OVERSIGHT  
BEHZAD GOLEMOHAMMADI  
DATE 10/01 REVISED BY 11/01 DATE REVISED  
CALCULATED/DESIGNED BY KC AB CHECKED BY






DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	132R2	1204





12-6-04  
PLANS APPROVAL DATE  
PB POWER, Inc.  
A Parsons Brinckerhoff Company  
303 Second St., Suite 700N  
San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>

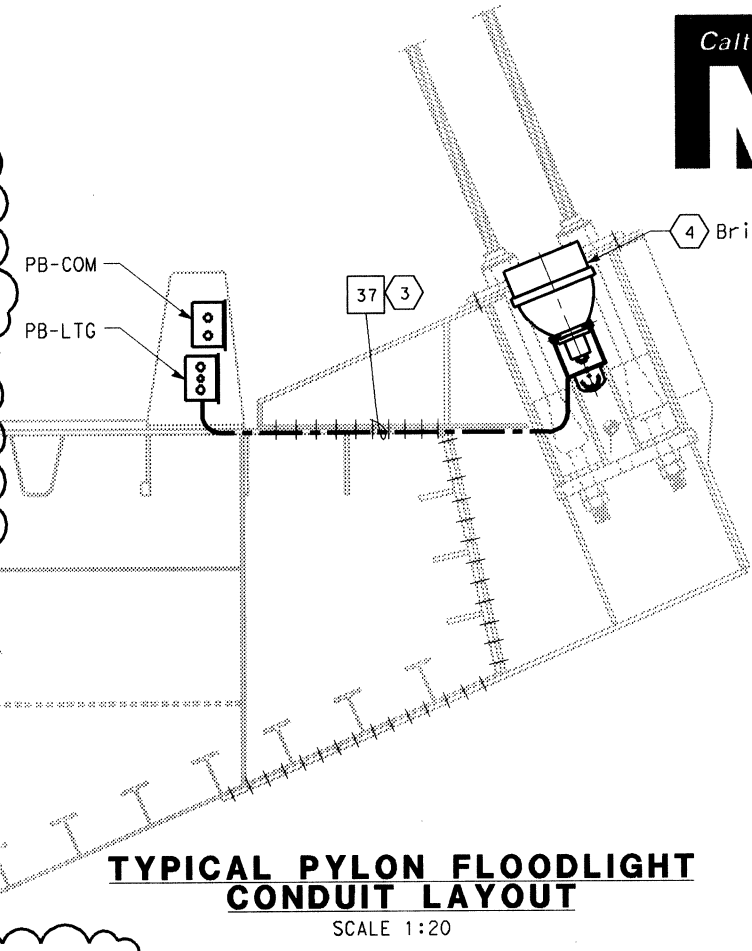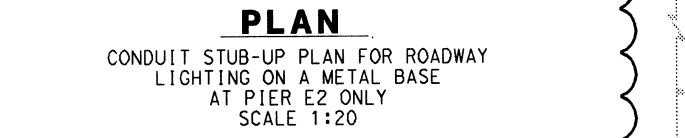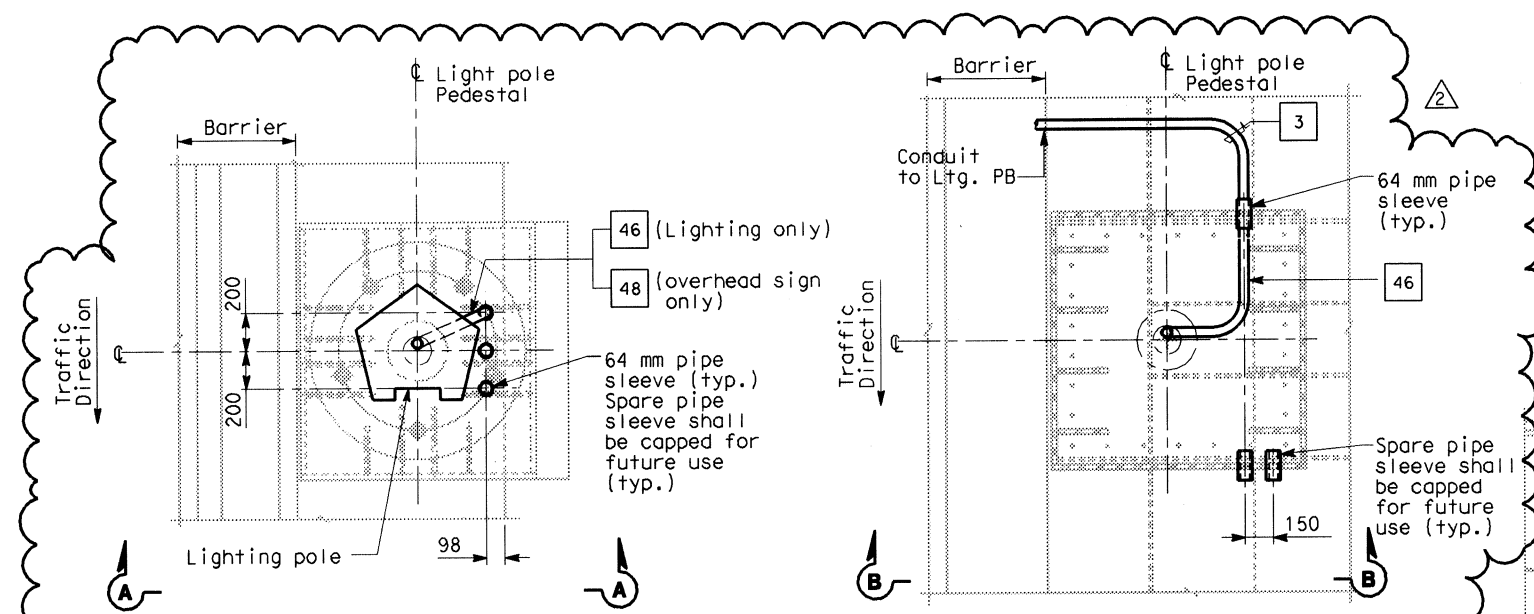

- SHEET NOTES:**
- 1 Bond grounding bushing to ground lug of lighting pole with #6 bare copper wire.
  - 2 Conduits for future light pipe shall continue from this pull box.
  - 3 Conduit shall be clear of all piping and pipe sleeves. Route conduit on top of deck plate, outside of girder box.
  - 4 For pylon floodlighting layout, see sheets E-47 & E-48.
  - 5 See Utility Detail No. 1 (Sheet No. 965 of 1204) for conduit penetration through girder plate and lighting pole metal base. The Contractor shall install sealant between the sleeve and conduit for future light pipe, plug and cap sleeve to prevent water or moisture from passing inside the sleeve.
- NOTES:**
1. References:  
- For lighting pole schedule, see sheet E-82.  
- For location of pull boxes inside girder, see sheets E-96 thru E-101.  
- For luminaire support details, see structural sheets.  
- For pull box schedule, see sheet E-83.

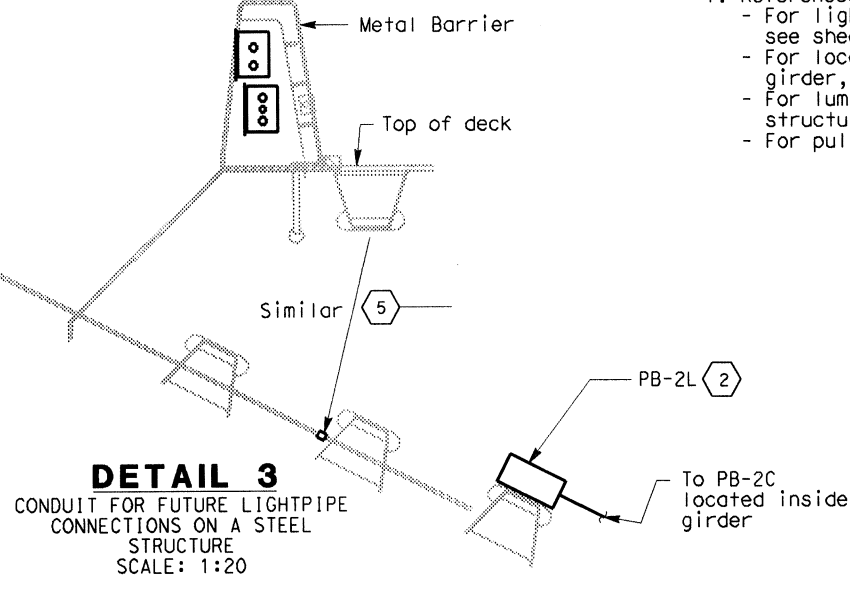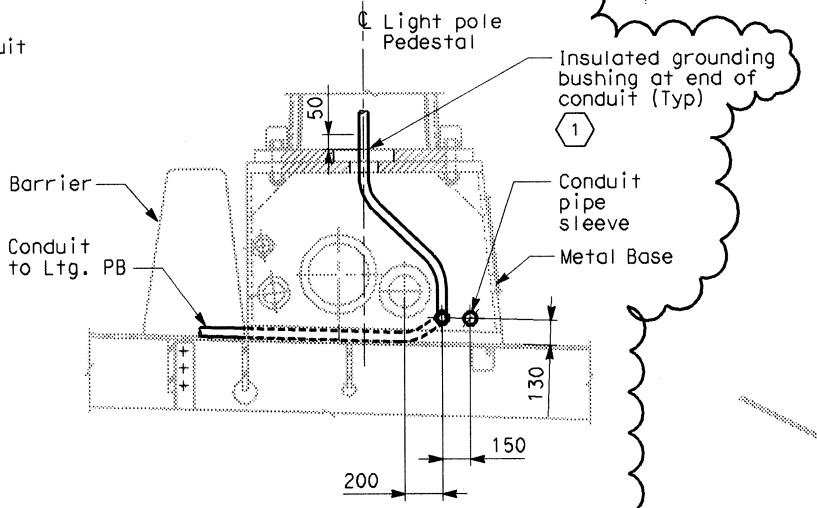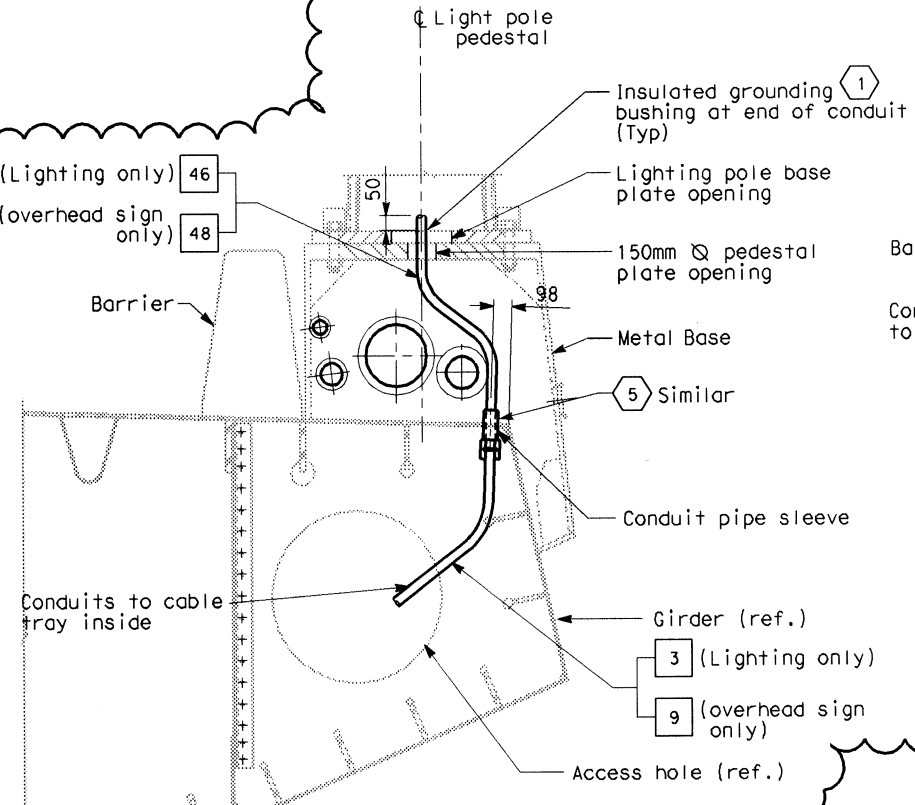

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
2	02/19/08	ELECTRICAL MODIFICATIONS	MP	RR	42
1	10/16/06	REVISED SHEET NOTES	LR	MG	11
REVISIONS					

CONTRACT CHANGE ORDER NO. \_\_\_\_\_  
FOR REVISION ONLY SHEET \_\_\_\_\_ OF \_\_\_\_\_

**DETAILS**  
**SAS SUPERSTRUCTURE ROADWAY WESTBOUND**  
**CONDUIT LOCATIONS**  
SCALE AS NOTED  
**E-67**